



FILTER

WATER IS LIFE, SANITATION IS DIGNITY

Guest User


Potable Overview

Summary

Gauteng > Water Service Authority > City of Tshwane Metropolitan Municipality > SANS 241:2015 > 2019

Drinking Water Quality in South Africa.

Map View

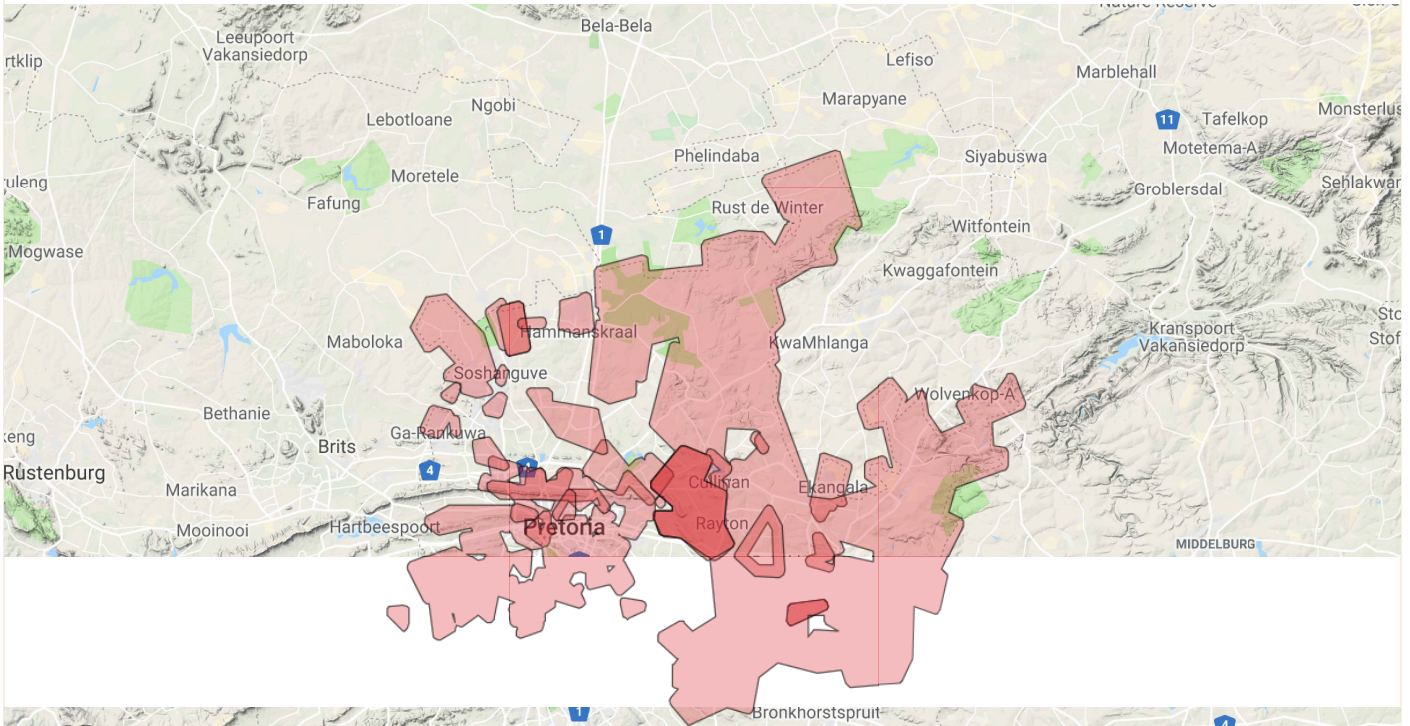

https://maps.google.com/maps?ll=-25.594831,28.494385&z=9&t=sat&hl=en&gl=US&map_ah=1&map_data=@@@

Gauteng > Water Service Authority > City of Tshwane Metropolitan Municipality > SANS 241:2015 > 2019

LEGEND Bad <95% Poor 95-97.0% Good 97.0-99% Excellent >99%

Programmes	Latest News	Documents	Contact Us	City of Tshwane Metropolitan Municipality	IRIS	INTEGRATED REGULATORY INFORMATION SYSTEM						
Effluent Overview	My Water	My River	Acute Health	Acute Health	Chronic Health	Aesthetic Chemical - Non Health	Operational	Disinfectant				
			Comply	*MRP	Comply	*MRP	Comply	*MRP	Comply	*MRP	Comply	*MRP
KUNGWINI -												
(Bronkhorstpruit Town WTW)	93.2%	32.5%	>99.9%	N/A	>99.9%	47.8%	95.3%	90.6%	78.6%	53.5%	33.9%	17.6%
KUNGWINI												
(Bronkhorstbaai WTW)	92.3%	40.0%	>99.9%	N/A	98.1%	0.0%	93.9%	>99.9%	76.9%	70.5%	43.1%	N/A
KUNGWINI												
(Summerplace WTW)	86.8%	40.0%	>99.9%	N/A	>99.9%	0.0%	92.8%	>99.9%	82.6%	70.5%	20.4%	N/A
MAGALIES (Cullinan WTW)												
	>99.9%	33.0%	>99.9%	N/A	99.3%	0.0%	99.8%	91.3%	96.7%	54.7%	27.2%	N/A
MAGALIES												
(Walmansthal WTW)	>99.9%	53.7%	85.8%	N/A	97.9%	0.0%	91.1%	>99.9%	90.4%	72.3%	27.8%	N/A
ONVERWACHT Informal settlement												
	72.7%	20.0%	>99.9%	N/A	98.5%	0.0%	>99.9%	99.2%	88.6%	67.9%	13.0%	N/A
PRETORIA Central & South (Rietvlei WTW & Rand Water)												
	>99.9%	N/A	>99.9%	N/A	>99.9%	N/A	99.9%	N/A	99.9%	N/A	41.7%	N/A
PRETORIA Findley (Fountains)												
	>99.9%	40.0%	>99.9%	N/A	>99.9%	0.0%	>99.9%	94.3%	>99.9%	59.4%	24.7%	N/A
PRETORIA North - (Roodeplaat WTW)												
	>99.9%	33.6%	>99.9%	N/A	99.9%	0.0%	99.3%	91.2%	99.1%	54.6%	26.7%	N/A
PRETORIA Temba (Temba WTW; Klipdrift WTW)												
	95.6%	38.8%	81.4%	N/A	98.9%	0.0%	91.9%	99.2%	86.9%	67.9%	25.6%	N/A
SOKHULUMI Informal Settlement												
	80.0%	10.0%	>99.9%	N/A	>99.9%	0.0%	96.2%	53.9%	71.9%	18.7%	0.0%	N/A
City of Tshwane Metropolitan Municipality												
	98.6%	35.9%	96.4%	N/A	99.6%	39.2%	97.8%	92.9%	95.5%	58.7%	35.2%	17.6%

FILTER

* MRP = Minimum Risk Parameters As Per SANS 241-2 2015 P10-11, Table 1-3

* based on summaries calculated on Sep 3 2019 1:00AM

Page Visits : 16 894

Site Visits : 202 528

